


NON - PROTECTUS METER STATION

COMPOUND METER AND STRAINER
CONTRACTOR TO SUPPLY SPOOL
PIECE DURING TESTING. SPOOL
PIECE LENGTH TO BE DETERMINED.

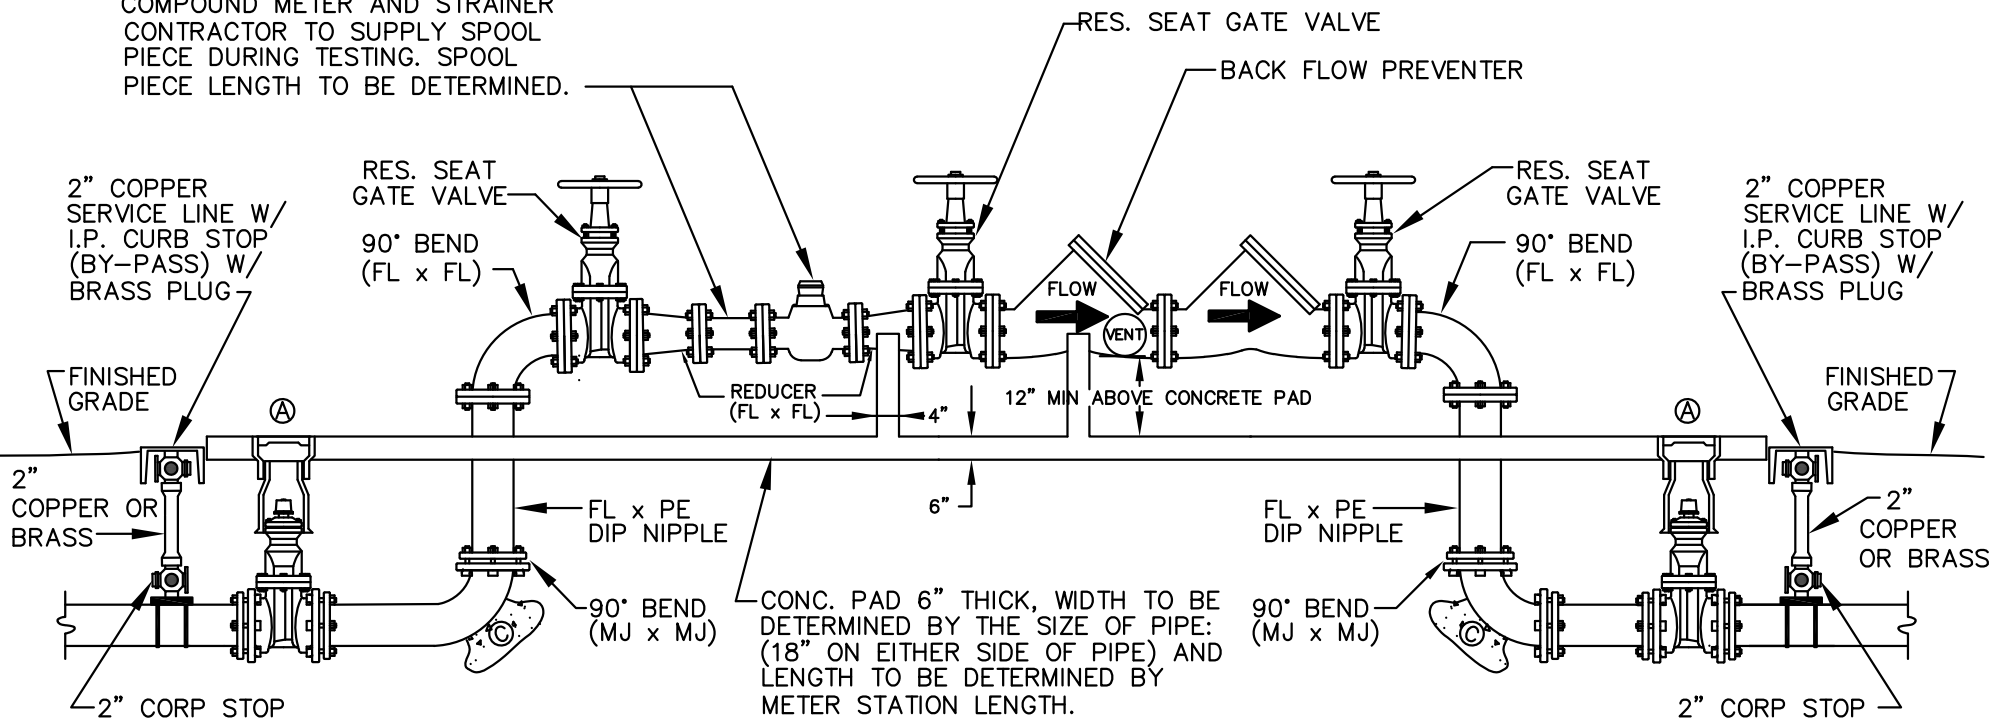

NOTE:

1. ASSEMBLY IS TO BE PAINTED RUST-O-THANE NO. 9407-1854 (BLUE)
2. ALL ABOVE GROUND BOLTS AND NUTS TO BE #304 STAINLESS STEEL.
3. ALTHREAD ROD WILL NOT BE PERMITTED.
4. 12" MIN. CLEARANCE FROM THE VENT ON THE BACKFLOW PREVENTER TO THE CONCRETE PAD.
5. 45° BENDS MAY BE USED WHEN PRIOR APPROVED BY ENGINEER.
6. ALL FITTINGS ARE RESTRAINED.
7. IN LIEU OF CONCRETE SUPPORTS, ADJUSTABLE STAINLESS STEEL SUPPORTS ALLOWED.
8. 2" COPPER SERVICE LINE TO BE INSTALLED ON BRASS SADDLE OR WELDED BOSS. 2" BRASS MAY BE USED IN LIEU OF COPPER.
9. ABOVE GROUND ASSEMBLY SHALL BE SETBACK A MINIMUM OF 3' FROM BACK OF CURB.

- Ⓐ REFER TO GATE VALVE & VALVE BOX DETAIL.
Ⓒ REFER TO THRUST BLOCK NOTES & DETAILS.



CITY OF COCOA
Brevard County, Florida
UTILITIES DEPARTMENT
ENGINEERING DIVISION

3 INCH AND LARGER METER WITH BACKFLOW PREVENTER ABOVE GROUND INSTALLATION

DRAWN BY: J. WILLIAMS	SCALE: NOT TO SCALE
CHECKED BY: P. DAVIS	DATE: OCTOBER 2022
DESIGN BY:	SHEET: 1 OF 1
ACAD NAME: 3 IN AND LARGER METER WITH BACKFLOW rev	